


GURNEE MILLS MALL

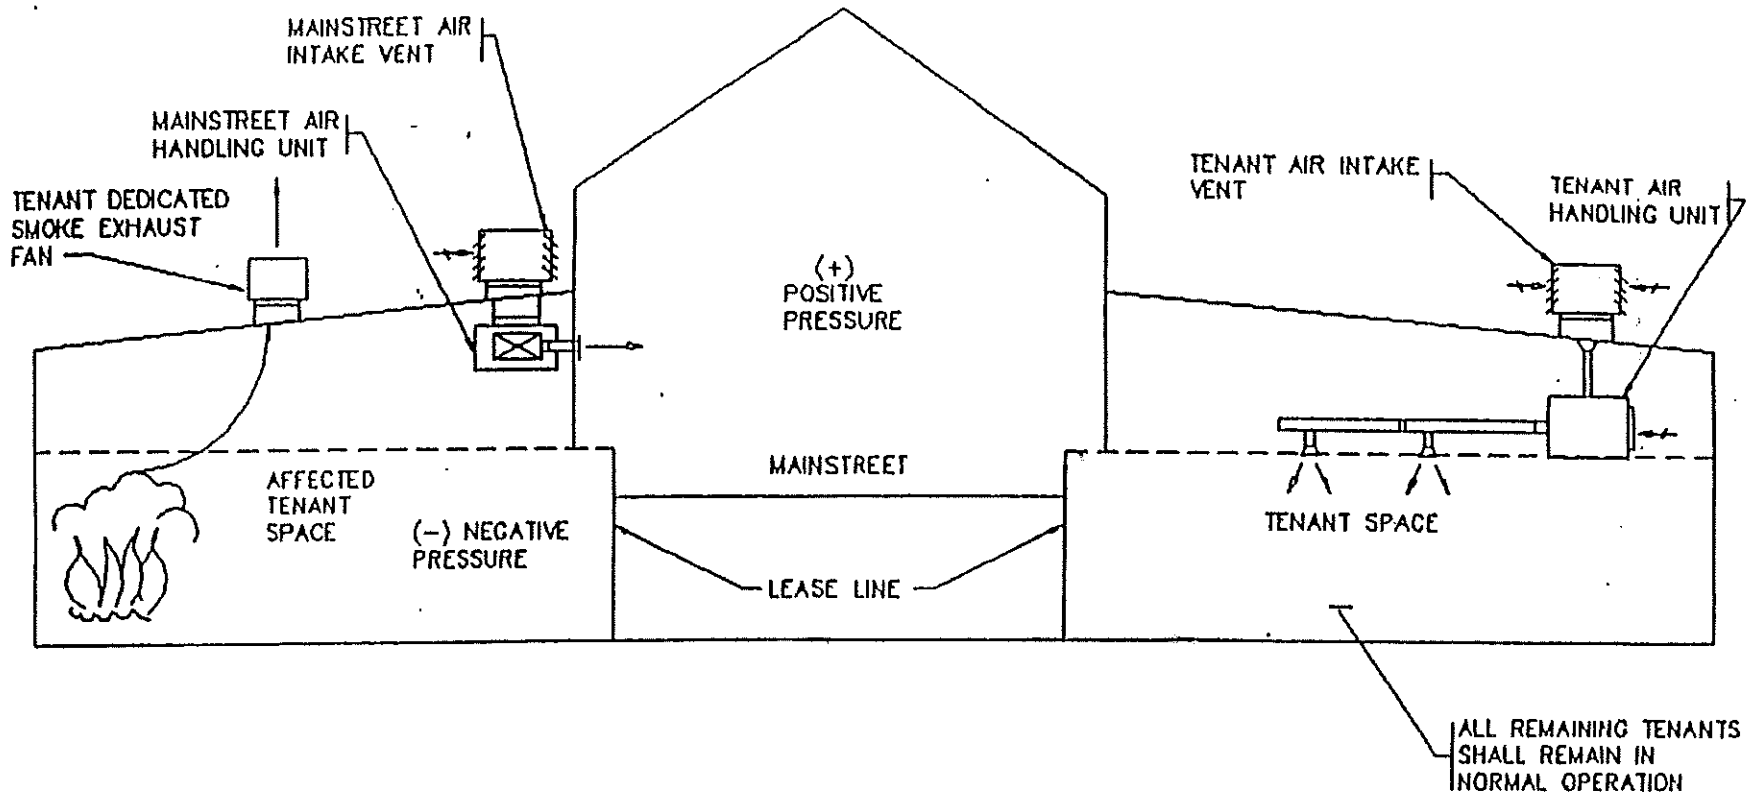

SEQUENCE:

AFFECTED TENANT ZONE	:	100% SMOKE EXHAUST, 0% SUPPLY
REMAINING TENANT ZONES	:	NORMAL OPERATION
ADJACENT MAINSTREET ZONES	:	100% O.A. SUPPLY, 0% RETURN
REMAINING MAINSTREET ZONES	:	NORMAL OPERATION

NOTE:

1. TENANT'S ENGINEER SHALL REFER TO MALL BASE BUILDING DRAWING H10.25 FOR SMOKE CONTROL ZONING. TENANT CONTRACTOR SHALL PROVIDE WIRING FROM CONTROL PANEL OF AHU TO BAS/FIRE ALARM SYSTEM CONTROL POINTS TO ALLOW FOR SHUT DOWN OF UNIT. FINAL CONNECTION SHALL BE DONE BY LANDLORD DESIGNATED CONTRACTOR.

TENANT SMOKE CONTROL SCHEMATIC